


Stone Panel, Curtain 19/129, 19/129, 19/129

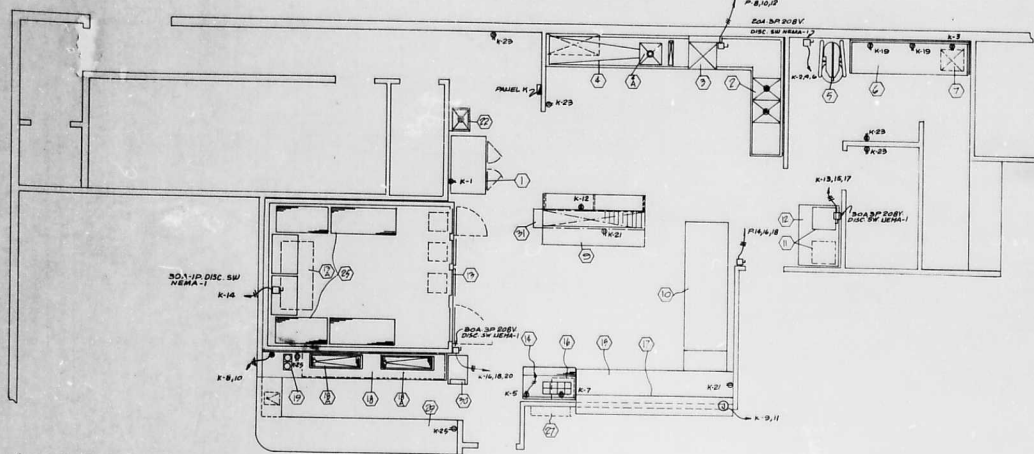


KITCHEN PLAN
SCALE 1/4"=1'-0"

TYPE: SQUARE LINE SERIES: MAIN DISTRIBUTION PANEL VOLTAGE: 200 Y/120 F 3 Ø 4W THREATH: SURFACE						PANEL P		MAIN BUS: 1000 AMPS NEUTRAL: 600 AMPS PINS: LUGS ONLY LOCATION: ELECT RM					
AMPS	POLES	TOTAL C.W.	CON- DUIT	WIRE	REMARKS	CKT. NO.	EXT. NO.	REMARKS	WIRE	CON- DUIT	TOTAL C.W.	POLES	AMPS
150	3	32.6	2	1/0	PANEL L	1	1	PANEL L	1/0	2	41.6	3	150
						2	2						
150	3	40	2	1/0	PANEL K	3	3	FISH WABBER	4	1/4	49	3	80
						4	4						
30	3	6	1/2	10	WATER LTR	5	5	PIZZA OVEN	3/0	2"	51	3	200
						6	6						
60	3	18	1	6	ROOFTOP-1	7	7	ROOF TOP-2	6	1	18	3	60
						8	8						
60	3	18	1	6	ROOFTOP-3	9	9	ROOFTOP-4	6	1	18	3	60
						10	10						
60	3	18	1	6	ROOFTOP-5	11	11	ROOF TOP-6	6	1	18	3	60
						12	12						
60	3	18	1	6	ROOFTOP-7	13	13	SPACE			5		
						14	14						

CONNECTED LOAD 318.2 KVA = 884 AMPS

FEDER 8 BAYS OF
FEED FROM THRU
FEED FROM SERVICE

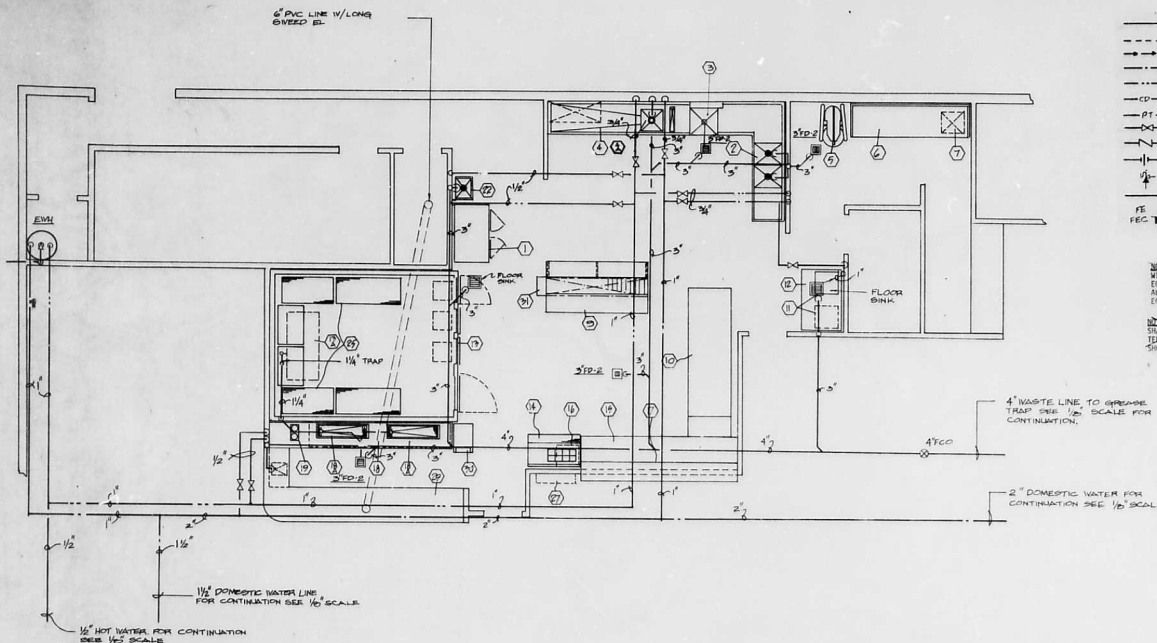

KITCHEN PLAN
SCALE: 1/4" = 1'-0"

PLUMBING FIXTURE CONNECTION SCHEDULE					
No	DESCRIPTION	DRAIN	WATER		REMARKS
			COLD	HOT	
WC	WATER CLOSET	4"	1/2"	—	
WCH	HAUDICAPPED WATER CLOSET	4"	1/2"	—	
UR	URINAL WALL HUNG	2"	3/4"	—	
L	LAVATORY	1 1/4"	1/2"	1/2"	

KITCHEN EQUIPMENT CONNECTION SCHEDULE						
EQUIP. NO.	EQUIPMENT NAME	WASTE	WATER		GAS	REMARKS
			CW	HW	PIPE SIZE	
2	DON TABLE 1/2" COMPARTMENT SINK	1/2"	1/2"	1/2"	—	
3	DISHWASHER	2"	—	1/2"	1/2" R/F	
4	SPLO DON TABLE 1/2" ONE COMPARTMENT SINK	1/2"	1/2"	1/2"	—	
5	PRE. RINSE ASSY.	—	1/2"	1/2"	—	
6	ICE BIN	1"	1/2"	—	—	
7	BKCK BWA UNIT	1/2"	1/2"	1/2"	—	
8	DRAIN TROUGH	1 1/4"	—	—	—	
9	COFFEE MAKER	—	1/2"	—	—	
10	HAND SINK	1/2"	1/2"	1/2"	—	

PLUMBING LEGEND

—	BUILDING SANITARY SEWER LINE	—	WALL CLEANOUT
---	VENT LINE	—	FLOOR CLEANOUT
—	GAS/WASTE DRAINAGE LINE	—	CLEANOUT TO GRADES
—	COLD WATER LINE	—	HOSE BIBBED
—	HOT WATER LINE	—	VACUUM BREAKER
—	CONDENSATE DRAIN LINE	—	VENT THRU ROOF
—	PRESSURE & TEMPERATURE RELIEF LINE	—	FLOOR DRAIN
—	CHATE VALVE	—	EXISTING FIRE WATER LINE
—	CHECK VALVE	—	EXISTING SANITARY LINE
—	COUPLING OR UNION	—	GAS/WASTE LINE
—	PRESSURE & TEMPERATURE RELIEF VALVE		
—	CLEAN OUT		
FE	FIRE EXTINGUISHER ON WALL BRACKET (2A-10BC)		
FE	FIRE EXTINGUISHER IN CABINET (2A-10BC)		

NOTE: THE CONTRACTOR SHALL VISIT THE SITE AND FAMILIARIZE HIMSELF WITH THE LOCATION OF ALL EXISTING UTILITIES, STUB OUTS, PIPING EQUIPMENT, ETC., AND/OR ANY CONDITION THAT MAY AFFECT HIS WORK. ALL THE NECESSARY REROUTING, AND/OR REMOVAL OF EXISTING PIPING EQUIPMENT, ETC., SHALL BE INCLUDED IN THE SCOPE OF WORK.

UNDER EXISTING FLOORING UNDER SINKS, REMAIN. CONTRACTOR SHALL MAKE ALL NECESSARY CHANGES, AND/OR ANY ADDITIONAL WATERTIGHTS, TO EXISTING SANITARY AND/OR GAS/WASTE LINES SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL PRIOR TO THE START OF WORK.

10/8/81

Manuel E. Lauredo & Assoc., Inc.
1000 N. Kendall Dr., Suite 205, Miami, FL 33135
Phone: (305) 452-2702

PIZZA TIME THEATRE
COUNTRY CLUB VILLAGE SQUARE
CLEARWATER, FLORIDA

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. Holladay Blvd., Suite 202, Hollywood, FL 33009
Phone: (305) 452-2702

william cook
murphy
architect
a.i.a.

E-2

3/4" EXT. GRADE PLYWOOD SHEATH
STAINED, FOLLOW ANGLES OF WALLS
& PARTS BELOW

3/4" EXT. GRADE PLYWOOD SHEATH
OVER 2x4 @ 16" O.C. SUPPORTED BY
GAL. METAL JOIST HANGERS, 5/8" TYPICAL
SPACING DETAIL, CEILING & WALLS

DISCRETE MIRROR

4x6 WOOD BEAM

4x4 WOOD POST CLAD WITH 5/8" TYPICAL
SPACING DETAIL

3/4" EXT. GRADE PLYWOOD SHEATH
OVER 2x4 @ 16" O.C. CLAD WITH CABINET

1/2" STEEL PIN

SECTION

3/4" EXT. GRADE PLYWOOD SHEATH STAINED
FOLLOW ANGLES OF WALLS & PARTS BELOW

3/4" EXT. GRADE PLYWOOD SHEATH OVER 2x4
WOOD JOIST @ 16" O.C. SUPPORTED BY
GAL. METAL JOIST HANGERS, 5/8" TYPICAL
SPACING DETAIL, CEILING & WALLS

4x6 WOOD BEAM SPACING 16" O.C.

CHEESE CHAWL PANEL

2x4 STUD WALL CLAD WITH 5/8" TYPICAL
SPACING DETAIL

SECTION

3/4" EXT. GRADE PLYWOOD SHEATH OVER 2x4
WOOD JOIST @ 16" O.C. SUPPORTED BY
GAL. METAL JOIST HANGERS, 5/8" TYPICAL
SPACING DETAIL, CEILING & WALLS

1x6 WOOD TRIM





2x4 STUD WALL CLAD WITH 5/8" TYPICAL
SPACING DETAIL & FINISH FLOORING
OUT SIDE SURFACES

CONSTRUCT A WOOD BEAM & STUDS
OF 3/4" EXT. GRADE PLYWOOD & 2x4s
EIGHT WHERE NOTED OTHERWISE

SECTION

ALL MEMBERS TO
BE NEW COMBUSTIBLE
FRAMING 10/11/81
C. J. LITTLE

PUBLIC CORRIDOR SEE FLOOR PLAN
A-2

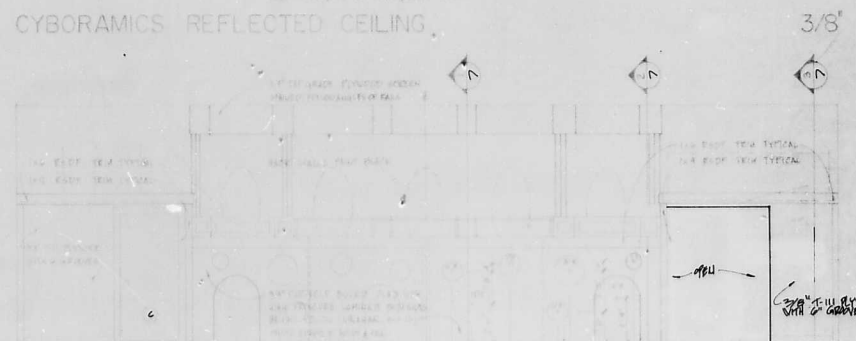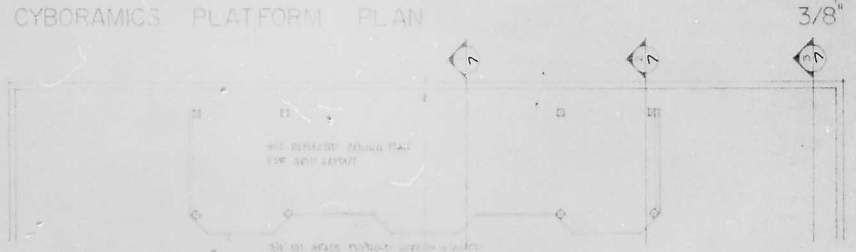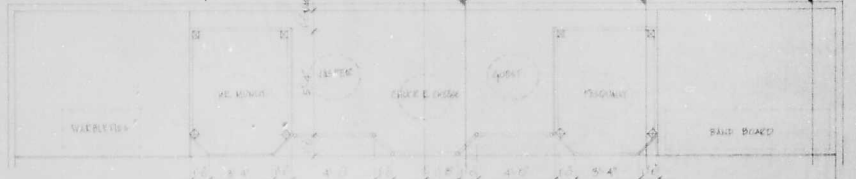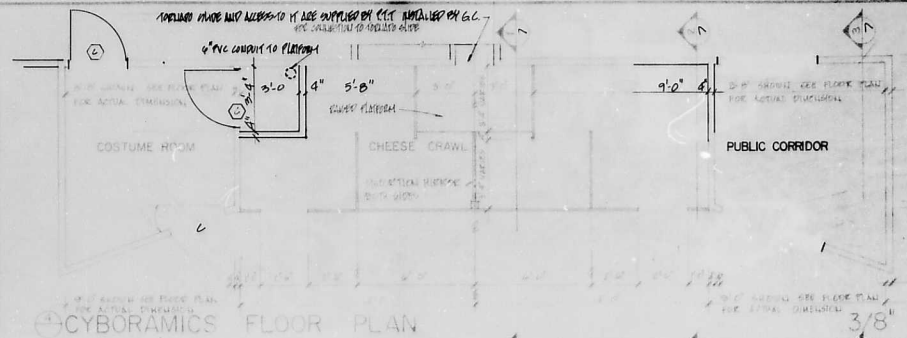


william cool
murphy
architect
702 N. KENDALL BLVD. SUITE 202
MIAMI, FL 33135
PHONE 305-355-5940


KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 N. KENDALL BLVD. SUITE 202
MIAMI, FL 33135
PHONE 305-456-2702

PIZZA TIME THEATRE
Office City by
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA


DATE: 10/1/81
BY: C. J. LITTLE
CHECKED: C. J. LITTLE

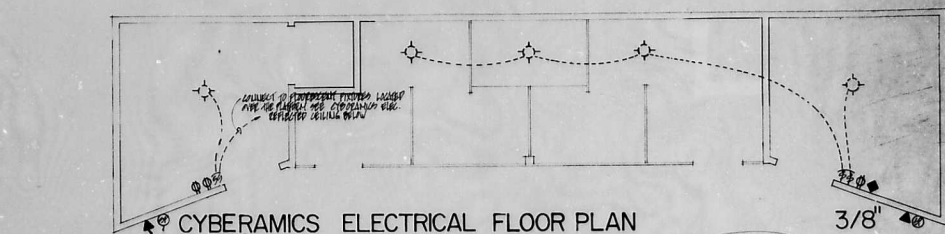

CYBERAMICS ELECTRICAL FLOOR PLAN

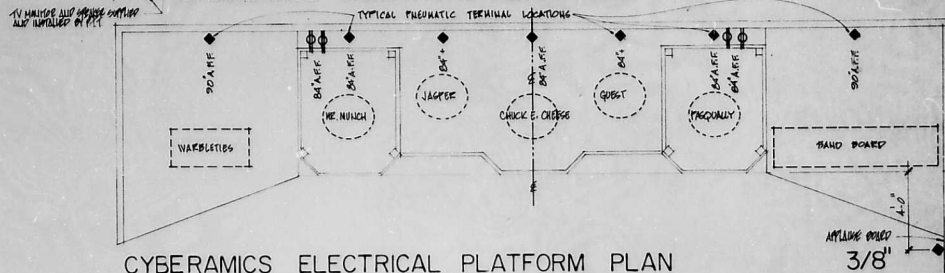

CYBERAMICS ELECTRICAL PLATFORM PLAN

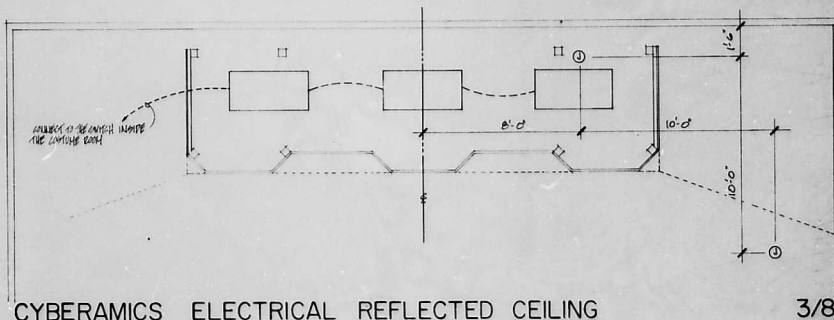

CYBERAMICS ELECTRICAL REFLECTED CEILING

william cook
murphy
architect a.i.a.
700 N. VENUE, LOW SUITE 210, MIAMI, FL 33136
P: 305.576.1100

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. HALLANDALE BOULEVARD, SUITE 202, HALLANDALE, FL 33009
Phone: (305) 496-2702


PIZZA TIME THEATRE
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA

DATE	REVISION	BY	CHECKED

(D) DOOR SPECIFICATION

DOOR
SIZE: 3'-0" X 6'-8" X 1 3/4" / CONSTRUCTION AND FINISH SOLID CORE WOOD
WITH PLASTIC LAMINATE NEVAMAN GOLDEN ASH W-8-110 / GLASS WIRE / FIRE
RATING NONE / SEE ELEVATION BELOW / FRAME 16 GAUGE STEEL PAINTED TO MATCH
DOOR SEE JAMB DETAIL

HARDWARE
HINGES 1 PAIR OF STANDARD WEIGHT 3 KNUCKLE WITH S/S PINS, BRUSHED CHROME
OR S/S FINISH, STANLEY OR MC KINNEY / LOCKSET ENTRANCE LOCKSET COMMERCIAL
GRADE DUTY, FEDERAL SPEC. FF-N-106, AND ANSI A156.2 CHROME OR S/S FINISH
PULL, LARGEST OR SCHLAGE / PULL OR PUSH PLATE NONE / CLOSER NONE /
WEATHER STRIPPING NONE / DOOR STOP DOME TYPE / NAME PLATE NONE / MAIL
SLIT NONE / ALARM NONE / THRESHOLD SEE DETAIL BELOW

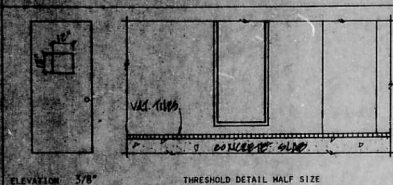


ELEVATION 3/8" THRESHOLD DETAIL HALF SIZE

(C) DOOR SPECIFICATIONS

DOOR
SIZE: 3'-0" X 6'-8" X 1 3/4" / CONSTRUCTION AND FINISH SOLID CORE WOOD
WITH PLASTIC LAMINATE NEVAMAN GOLDEN ASH W-8-110 / GLASS WIRE / FIRE
RATING NONE / SEE ELEVATION BELOW / FRAME 16 GAUGE STEEL PAINTED TO MATCH
DOOR SEE JAMB DETAIL

HARDWARE
HINGES 1 PAIR OF STANDARD WEIGHT 3 KNUCKLE WITH S/S PINS, BRUSHED CHROME
OR S/S FINISH, STANLEY OR MC KINNEY / LOCKSET ENTRANCE LOCKSET COMMERCIAL
GRADE DUTY, FEDERAL SPEC. FF-N-106, AND ANSI A156.2 CHROME OR S/S FINISH
PULL, LARGEST OR SCHLAGE / PULL OR PUSH PLATE NONE / CLOSER NONE /
WEATHER STRIPPING NONE / DOOR STOP DOME TYPE / NAME PLATE NONE / MAIL
SLIT NONE / ALARM NONE / THRESHOLD SEE DETAIL BELOW

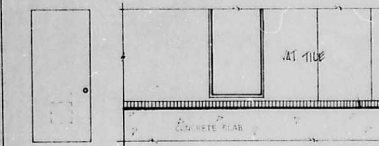

ELEVATION 3/8" THRESHOLD DETAIL HALF SIZE


NOTE:

(B) DOOR SPECIFICATION

DOOR
SIZE: 2'-8" X 6'-8" X 1 3/4" / CONSTRUCTION AND FINISH SOLID CORE WOOD
GLAD WITH NEVAMAN GOLDEN ASH W-8-110 / GLASS WIRE / FIRE RATING NONE /
FRAME 16 GA. STEEL PAINTED TO MATCH DOOR SEE JAMB DETAIL
SEE ELEVATION BELOW

HARDWARE
HINGES 1 PAIR OF STANDARD WEIGHT 3 KNUCKLE WITH S/S PINS, BRUSHED
CHROME OR S/S FINISH, STANLEY OR MC KINNEY / LOCKSET NONE / PANIC HARDWARE NONE
PULL AND PUSH PLATE BRUSHED CHROME OR S/S / CLOSER LCN WOOD SURFACE
MOUNTED OUT OPENING DOORS SHALL HAVE CLOSER MOUNTED INSIDE / WEATHER
STRIPPING NONE / DOOR STOP DOME TYPE / NAME PLATE "HENT" OR "HNT"
MAIL SLIT NONE / ALARM NONE / THRESHOLD NONE SEE DETAIL

ALTERNATE
MATCHING MAILITE DOORS AND FRAMES

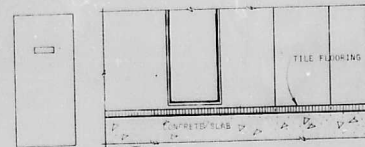


ELEVATION 3/8" THRESHOLD DETAIL HALF SIZE


(A) DOOR SPECIFICATION

DOOR
SIZE: 3'-0" X 7'-0" X 1 3/4" / CONSTRUCTION AND FINISH, KAMNEER 350
PERMANENT AND BRONZE, WITH TEMPERED PLATE GLASS BRONZE / FIRE RATING NONE
SEE ELEVATION BELOW; SEE FRAME DETAIL


HARDWARE
HINGES KAMNEER 3 OFFSET HINGES / LOCKSET COMMERCIAL DUTY ENTRANCE LOCK
KEYED LIKE OTHER EXTERIOR DOORS / PANIC HARDWARE; KAMNEER PANELINE EXIT
DEVICE WITH MATCHING SIDE PANELS AT SIDE LITES / PULL, KAMNEER G-2 /
CLOSER; KAMNIN SAN 11 WITH NO HOLD OPEN / WEATHER STRIPPING KAMNEER
SEALAIR / DOOR STOP NONE / NAME PLATE NONE / MAIL SLIT IN SIDE LITES
ADJACENT TO DOORS / ALARM NONE THRESHOLD SEE DETAIL

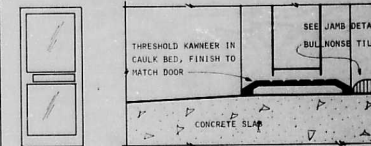

ELEVATION 3/8" THRESHOLD DETAIL HALF SIZE

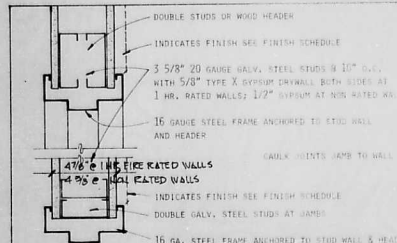


HEAD & JAMB INTERIOR 3"

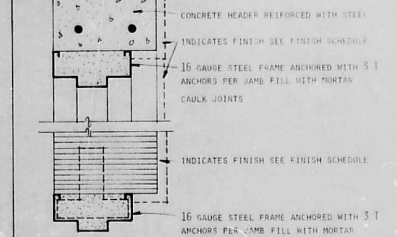

HEAD & JAMB INTERIOR 3"

MISCELLANEOUS DOOR NOTES

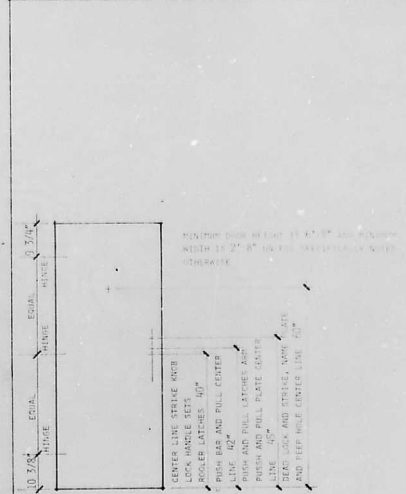


HARDWARE LOCATION 3/4"

(E) DOOR SPECIFICATION

DOOR
SIZE: 3'-0" X 6'-8" X 1 3/4" CONSTRUCTION AND FINISH SOLID CORE WOOD
GLAD WITH NEVAMAN GOLDEN ASH W-8-110 / GLASS WIRE 12"x12" 1 HR. FIRE
RATING FROM 16 GA. STEEL PAINTED TO MATCH SEE JAMB DETAIL
SEE ELEVATION BELOW

HARDWARE
HINGES 1 PAIR SPRING DOUBLE ACTING BY BOMMER # 3024-8
LOCKSETS NONE / PANIC HARDWARE NONE / PULL AND PUSH PLATE BRUSHED
CHROME OR S/S / CLOSER NONE /
WEATHER
STRIPPING NONE / DOOR STOP DOME TYPE / NAME PLATE
MAIL SLIT NONE / ALARM NONE / THRESHOLD NONE SEE DETAIL

ALTERNATE
MATCHING MAILITE DOORS AND FRAMES

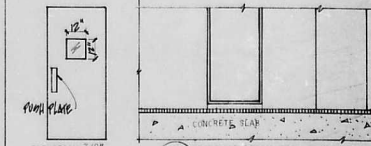

ELEVATION 3/8" THRESHOLD DETAIL HALF SIZE

william cook murphy architect aia.

PIZZA TIME THEATRE


COUNTRYSIDE VILLAGE SQUARE

CLEARWATER, FLORIDA

DATE: 10/10/00 BY: [signature] CHECKED: [signature]

9

66722D

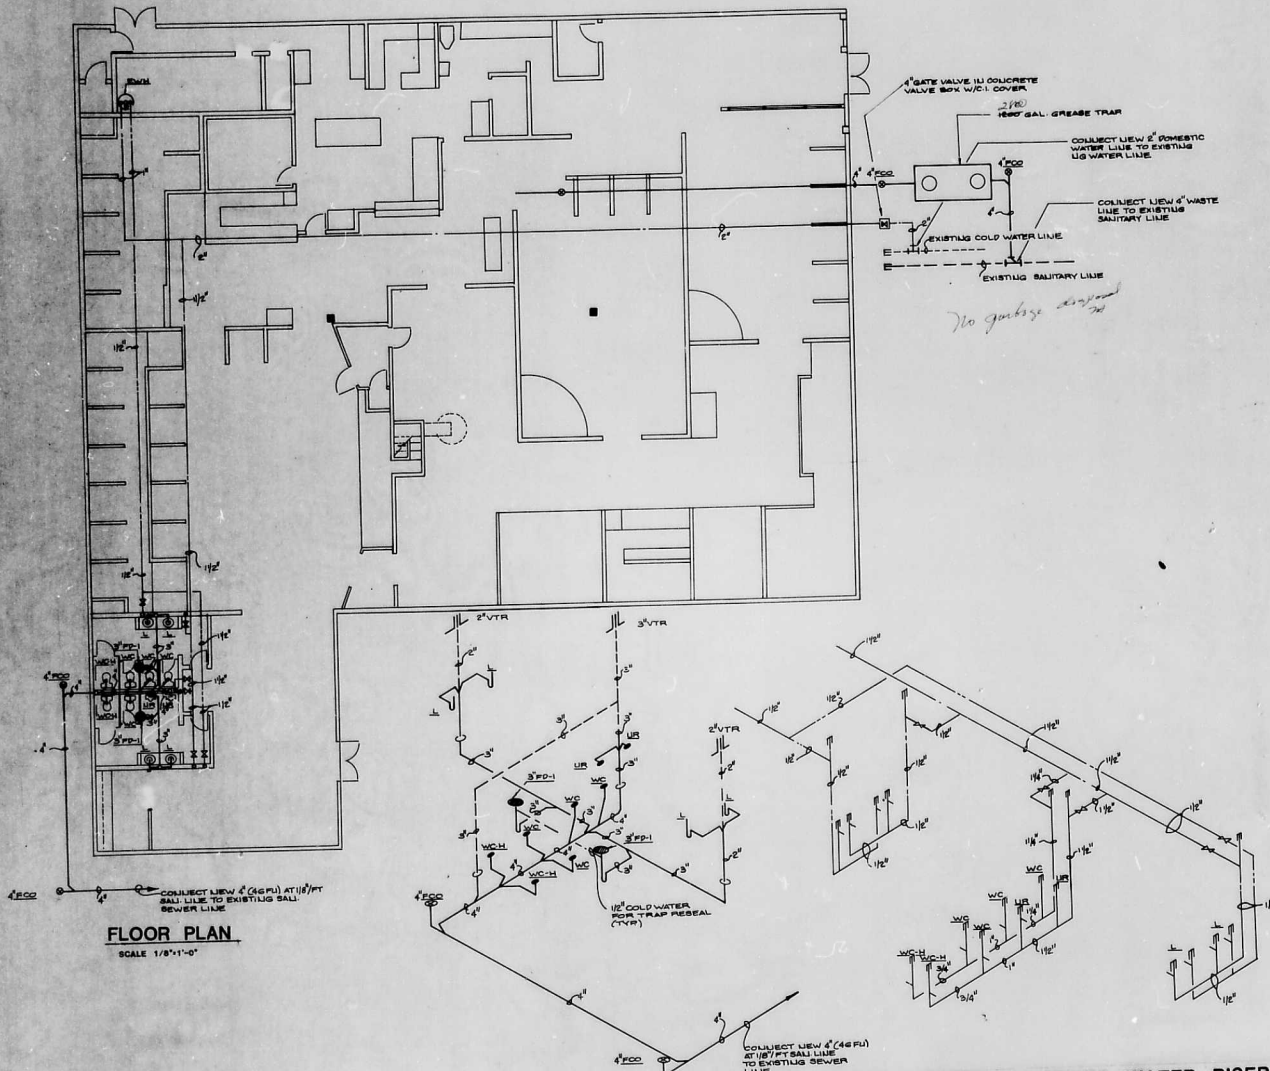

PUBLIC TOILETS SANITARY RISER DIAGRAM **PUBLIC TOILETS DOMESTIC WATER RISER DIAGRAM**
N.T.S. N.T.S.

Manuel E. Lando & Assoc., Inc.
CONSULTING ENGINEERS
1001 N. W. 10th St.
MIAMI, FL 33136


DATE: 10/1/88
BY: [Signature]
CHECKED: [Signature]
DRAWN: [Signature]

PIZZA TIME THEATRE
COUNTRYCRE VILLAGE SQUARE
DEERWATER, FLORIDA
[Signature]


KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. Holladay Blvd. Suite 202 - Hollywood, FL 33009
Phone: (305) 455-2702

william cook
murphy
architect
a.i.a.

46770

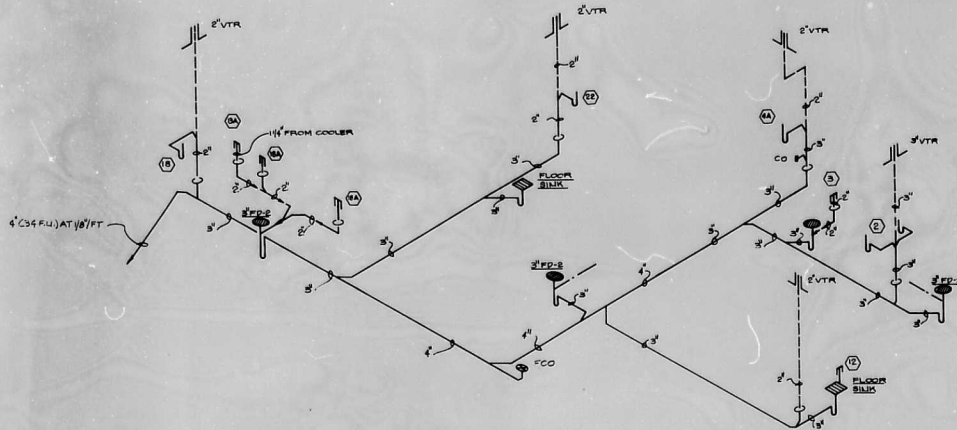

KITCHEN-SANITARY WASTE RISER DIAGRAM
N.T.S.

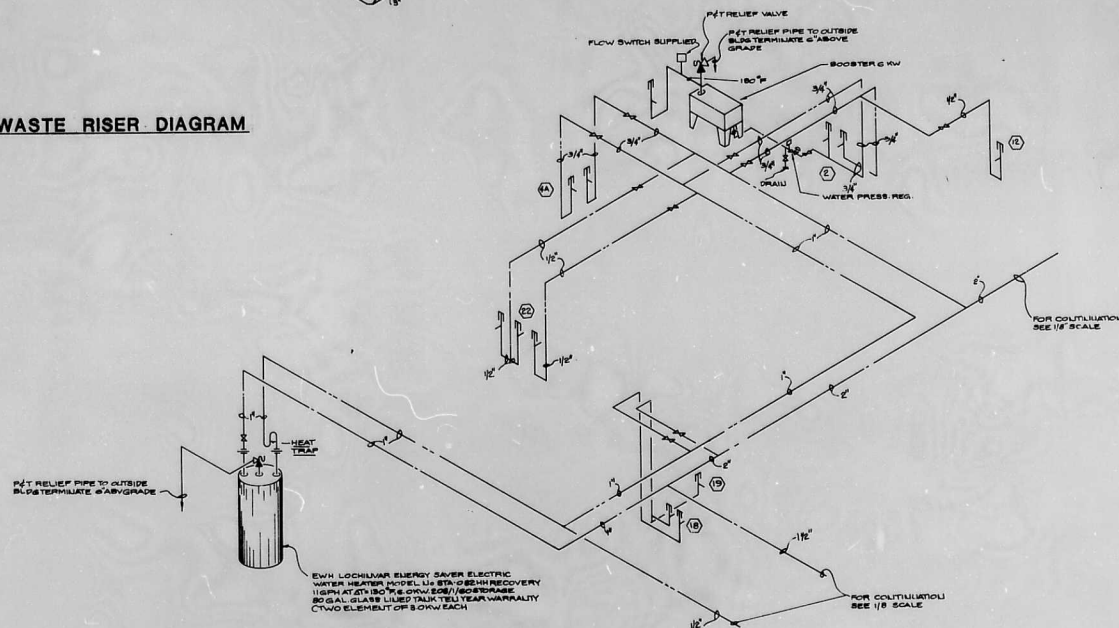

KITCHEN-DOMESTIC WATER RISER DIAGRAM
N.T.S.

Manuel E. Larrondo & Assoc., Inc.
CONSULTING ENGINEERS
SINCE 1960
SINCE 1960



DATE	BY	CHECKED
10/1/77	MANUEL E. LARRONDO	
10/1/77	JOSEPH A. LARRONDO	
10/1/77	JOSEPH A. LARRONDO	
10/1/77	JOSEPH A. LARRONDO	
10/1/77	JOSEPH A. LARRONDO	

PIZZA TIME THEATRE
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA


KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. Hialeah Blvd., Suite 202 - Hialeah, Fla. 33009
Phone (305) 456-2702

William Murphy
architect
a.i.a.



INDEX OF SHEETS

1. TITLE SHEET - LOCATION MAP
2. FLOOR PLAN
3. REFLECTED CEILING PLAN
4. INTERIOR ELEVATIONS
5. DETAILS - FINISH SCHEDULE
6. DETAILS
7. CYBERAMICS
8. CYBERAMICS
9. DOOR SCHEDULE
10. SPECIFICATIONS
- AC-1 AIR CONDITIONING
- P-1 PLUMBING
- P-2 PLUMBING
- P-3 PLUMBING
- E-1 ELECTRICAL
- E-2 ELECTRICAL
- E-3 ELECTRICAL
- E-4 ELECTRICAL, PNEUMATIC SYSTEMS



LOCATION MAP

APPROVED: PINELLAS COUNTY HEALTH DEPT.
FOR Food Service WITH PROVISION
DATE ISSUED DATED 8/22/81
David K. Reunder
SANITARIAN SUPERVISOR

PLANS EXAMINED, AND ARE APPROVED FOR RELEASE AS NOTED.	
Signature	Date
<u>[Signature]</u>	<u>8/22/81</u>
ZONING	<u>J. W. Mc. Feb. 1989</u>
FIRE	<u>[Signature]</u>
BUILDING	<u>[Signature]</u>
ELECTRICAL	<u>[Signature]</u>
PLUMBING	<u>[Signature]</u>
MECHANICAL	<u>[Signature]</u>

These Plans are Approved for Permit Under the Conditions Set Forth Under SEC. 10-1, Standard Building Code.

(Date) 8/22/81
(Signature of Official) [Signature]

CITY SET
2539 COUNTRYSIDE

PIZZA TIME THEATRE
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA

william cook
muller
architect
a.i.a.
1001 N. VERDELLA DR. SUITE 200 MIAMI, FL 33136 305 585 5940


KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. HOLLYWOOD BLVD. 2ND. FLOOR HOLLYWOOD, FL 33020
Phone: (305) 456-2702

Returned To Applicant
Aug 19 - 81

RECEIVED
BUILDING DEPT.
CITY OF CLEARWATER
AUG 18 1981

#6077D
991

DATE	REVISION	CHECKED	BY
10-8-81			

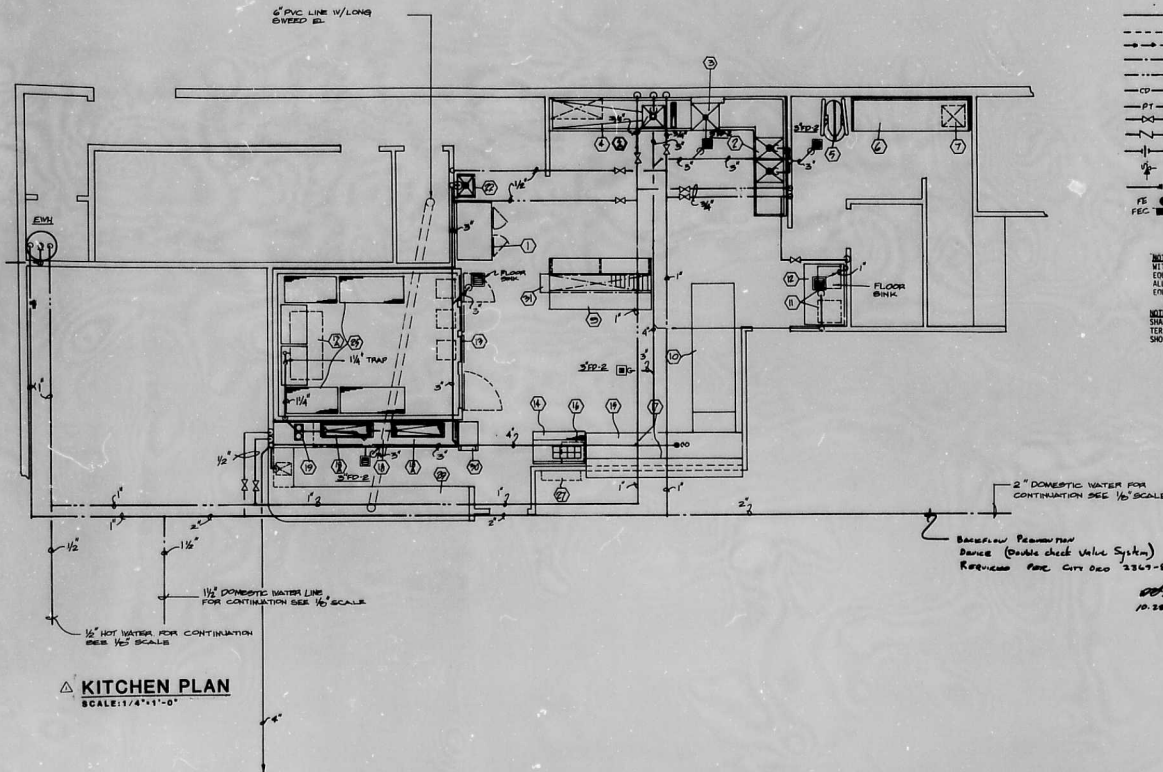

KITCHEN PLAN
SCALE: 1/4" = 1'-0"

PLUMBING FIXTURE CONNECTION SCHEDULE				
NO	DESCRIPTION	DRAIN	WATER COLD HOT	REMARKS
WC	WATER CLOSET	4"	1/2"	—
WC	HAUDICAPPED WATER CLOSET	4"	1/2"	—
UR	URINAL/WALL HUNG	2"	3/4"	—
L	LAVATORY	1 1/4"	1/2"	1/2"

KITCHEN EQUIPMENT CONNECTION SCHEDULE

EQUIP. NO.	EQUIPMENT NAME	WASTE	WATER		GAS		REMARKS
			CW	HW	PIPE SIZE	BTU/Hr.	
②	DISH TABLE 1/2" COMPARTMENT SINK	1 1/2"	1/2"	1/2"	—	—	
③	DISHWASHER	2"	—	1/2"	1/2"	—	
④	SOLID DISH TABLE 1/2" COMPARTMENT SINK	1 1/2"	1/2"	1/2"	—	—	
⑤	PRE. PRESS. ASST.	—	1/2"	1/2"	—	—	
⑥	ICE BIN	—	1"	1/2"	—	—	
⑦	BKCH. EXHA. UNIT	—	1 1/2"	1/2"	—	—	
⑧	DRAIN TROUGH	1 1/4"	—	—	—	—	
⑨	COFFEE MAKER	—	1/2"	—	—	—	
⑩	HAND SINK	1 1/2"	1/2"	1/2"	—	—	

PLUMBING LEGEND

—	BUILDING SANITARY SEWER LINE	—	WALL CLEANOUT
- - -	VENT LINE	—	FLOOR CLEANOUT
- - -	SAFETY/VENT DRAINAGE LINE	—	CLEANOUT TO OUTSIDE
- - -	COLD WATER LINE	—	HOSE END
- - -	HOT WATER LINE	—	VACUUM BREAKER
- - -	CONDENSATE DRAIN LINE	—	VENT THRU ROOF
- - -	PRESSURE & TEMPERATURE RELIEF LINE	—	FLOOR DRAIN
- - -	CHATE VALVE	—	EXISTING FIRE WATER LINE
- - -	CHECK VALVE	—	EXISTING SANITARY LINE
- - -	COUPLING OR UNION	—	GREASE WASTE LINE
- - -	PRESSURE & TEMPERATURE RELIEF VALVE		
- - -	CLEAN OUT		
FE	FIRE EXTINGUISHER ON WALL BRACKET (2A-10BC)		
FE	FIRE EXTINGUISHER IN CABINET (2A-10BC)		

NOTE: THE CONTRACTOR SHALL VISIT THE SITE AND FAMILIARIZE HIMSELF WITH THE LOCATION OF ALL EXISTING UTILITIES, STUB OUTS, PIPING EQUIPMENT, ETC., AND/OR ANY CONDITION THAT MAY AFFECT HIS WORK. ALL THE NECESSARY REROUTING, AND/OR REMOVAL OF EXISTING PIPING EQUIPMENT, ETC., SHALL BE INCLUDED IN THE SCOPE OF WORK.

NOTE: EXISTING FIRE SPRINKLER SYSTEM SHALL REMAIN. CONTRACTOR SHALL MAKE ALL NECESSARY CHANGES, INCLUDING ANY ADDITIONAL MATERIALS, TO COMPLY WITH NEW LAYOUT. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL PRIOR TO INSTALLATION.

2" DOMESTIC WATER FOR CONTINUATION SEE 1/2" SCALE
BASEFLOU PERMUTATION DRAIN (Double check Valve System)
Requires FIRE CITY 020 2349-B1

10.20.01


Michael E. Lando & Assoc., Inc.
CONSULTING ENGINEERS
REGISTERED PROFESSIONAL ENGINEERS
STATE OF FLORIDA
NO. 10,000,000

william cook
murphy
architects
a.i.a.

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. Highland Ave. Bldg. 202, Hollywood, FL 33009
Phone (305) 456-2702

PIZZA TIME THEATRE
COUNTRY CLUB VILLAGE SQUARE
CLEARWATER, FLORIDA

DATE	BY	CHECKED
10/20/01	10/20/01	10/20/01

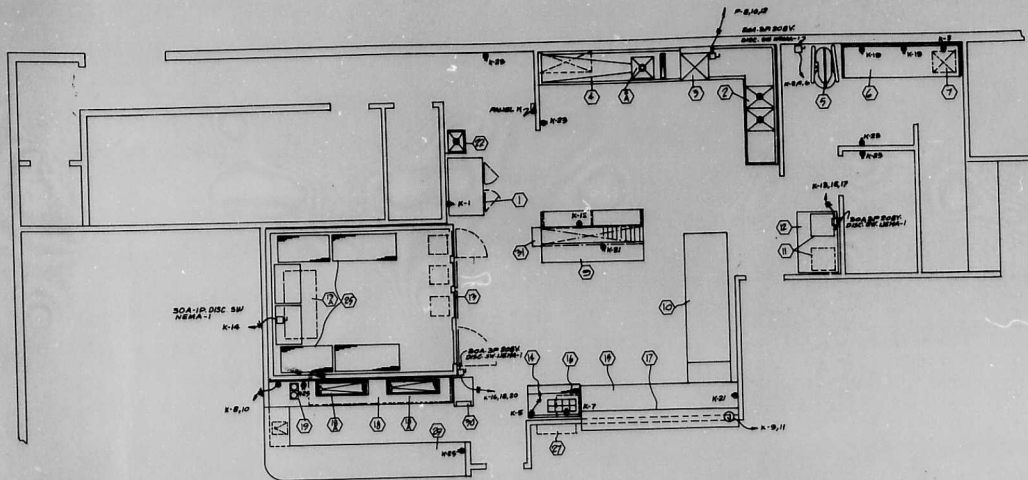


KITCHEN PLAN
SCALE 1/4"=1'-0"

TYPE SQUARED ILLUE
SERVICED MAIN DISTRIBUTION PANEL
VOLTAGE 208Y/120V 3Ø4W
MOUNTING SURFACE

PANEL P

MAIN BUS: 800 AMPS
NEUTRAL: 600 AMPS
WIRE: 4/0 CU
LOCATION: ELECT. RM.


AMPS	POLES	TOTAL KVA	WIRE	REMARKS	EXT. NO.	REMARKS	WIRE	CON- DUIT	TOTAL POLES	AMPS
150	3	22.5	2	1/0 PAU-1	1				2	150
150	3	40	2	1/0 PAU-1	2				2	150
150	3	40	2	1/0 PAU-1	3				2	150
30	3	6	1/2	10 WATER MTR	15				1	30
60	3	18	1	6 ROOF TOP-1	21				1	60
60	3	18	1	6 ROOF TOP-2	22				1	60
60	3	18	1	6 ROOF TOP-3	23				1	60
60	3	18	1	6 ROOF TOP-4	24				1	60
60	3	18	1	6 ROOF TOP-5	25				1	60
60	3	18	1	6 ROOF TOP-6	26				1	60
60	3	18	1	6 ROOF TOP-7	27				1	60
60	3	18	1	6 ROOF TOP-8	28				1	60
60	3	18	1	6 ROOF TOP-9	29				1	60
60	3	18	1	6 ROOF TOP-10	30				1	60
60	3	18	1	6 ROOF TOP-11	31				1	60
60	3	18	1	6 ROOF TOP-12	32				1	60
60	3	18	1	6 ROOF TOP-13	33				1	60
60	3	18	1	6 ROOF TOP-14	34				1	60
60	3	18	1	6 ROOF TOP-15	35				1	60
60	3	18	1	6 ROOF TOP-16	36				1	60
60	3	18	1	6 ROOF TOP-17	37				1	60
60	3	18	1	6 ROOF TOP-18	38				1	60
60	3	18	1	6 ROOF TOP-19	39				1	60
60	3	18	1	6 ROOF TOP-20	40				1	60
60	3	18	1	6 ROOF TOP-21	41				1	60
60	3	18	1	6 ROOF TOP-22	42				1	60
60	3	18	1	6 ROOF TOP-23	43				1	60
60	3	18	1	6 ROOF TOP-24	44				1	60
60	3	18	1	6 ROOF TOP-25	45				1	60
60	3	18	1	6 ROOF TOP-26	46				1	60
60	3	18	1	6 ROOF TOP-27	47				1	60
60	3	18	1	6 ROOF TOP-28	48				1	60
60	3	18	1	6 ROOF TOP-29	49				1	60
60	3	18	1	6 ROOF TOP-30	50				1	60
60	3	18	1	6 ROOF TOP-31	51				1	60
60	3	18	1	6 ROOF TOP-32	52				1	60
60	3	18	1	6 ROOF TOP-33	53				1	60
60	3	18	1	6 ROOF TOP-34	54				1	60
60	3	18	1	6 ROOF TOP-35	55				1	60
60	3	18	1	6 ROOF TOP-36	56				1	60
60	3	18	1	6 ROOF TOP-37	57				1	60
60	3	18	1	6 ROOF TOP-38	58				1	60
60	3	18	1	6 ROOF TOP-39	59				1	60
60	3	18	1	6 ROOF TOP-40	60				1	60
60	3	18	1	6 ROOF TOP-41	61				1	60
60	3	18	1	6 ROOF TOP-42	62				1	60
60	3	18	1	6 ROOF TOP-43	63				1	60
60	3	18	1	6 ROOF TOP-44	64				1	60
60	3	18	1	6 ROOF TOP-45	65				1	60
60	3	18	1	6 ROOF TOP-46	66				1	60
60	3	18	1	6 ROOF TOP-47	67				1	60
60	3	18	1	6 ROOF TOP-48	68				1	60
60	3	18	1	6 ROOF TOP-49	69				1	60
60	3	18	1	6 ROOF TOP-50	70				1	60
60	3	18	1	6 ROOF TOP-51	71				1	60
60	3	18	1	6 ROOF TOP-52	72				1	60
60	3	18	1	6 ROOF TOP-53	73				1	60
60	3	18	1	6 ROOF TOP-54	74				1	60
60	3	18	1	6 ROOF TOP-55	75				1	60
60	3	18	1	6 ROOF TOP-56	76				1	60
60	3	18	1	6 ROOF TOP-57	77				1	60
60	3	18	1	6 ROOF TOP-58	78				1	60
60	3	18	1	6 ROOF TOP-59	79				1	60
60	3	18	1	6 ROOF TOP-60	80				1	60
60	3	18	1	6 ROOF TOP-61	81				1	60
60	3	18	1	6 ROOF TOP-62	82				1	60
60	3	18	1	6 ROOF TOP-63	83				1	60
60	3	18	1	6 ROOF TOP-64	84				1	60
60	3	18	1	6 ROOF TOP-65	85				1	60
60	3	18	1	6 ROOF TOP-66	86				1	60
60	3	18	1	6 ROOF TOP-67	87				1	60
60	3	18	1	6 ROOF TOP-68	88				1	60
60	3	18	1	6 ROOF TOP-69	89				1	60
60	3	18	1	6 ROOF TOP-70	90				1	60
60	3	18	1	6 ROOF TOP-71	91				1	60
60	3	18	1	6 ROOF TOP-72	92				1	60
60	3	18	1	6 ROOF TOP-73	93				1	60
60	3	18	1	6 ROOF TOP-74	94				1	60
60	3	18	1	6 ROOF TOP-75	95				1	60
60	3	18	1	6 ROOF TOP-76	96				1	60
60	3	18	1	6 ROOF TOP-77	97				1	60
60	3	18	1	6 ROOF TOP-78	98				1	60
60	3	18	1	6 ROOF TOP-79	99				1	60
60	3	18	1	6 ROOF TOP-80	100				1	60
60	3	18	1	6 ROOF TOP-81	101				1	60
60	3	18	1	6 ROOF TOP-82	102				1	60
60	3	18	1	6 ROOF TOP-83	103				1	60
60	3	18	1	6 ROOF TOP-84	104				1	60
60	3	18	1	6 ROOF TOP-85	105				1	60
60	3	18	1	6 ROOF TOP-86	106				1	60
60	3	18	1	6 ROOF TOP-87	107				1	60
60	3	18	1	6 ROOF TOP-88	108				1	60
60	3	18	1	6 ROOF TOP-89	109				1	60
60	3	18	1	6 ROOF TOP-90	110				1	60
60	3	18	1	6 ROOF TOP-91	111				1	60
60	3	18	1	6 ROOF TOP-92	112				1	60
60	3	18	1	6 ROOF TOP-93	113				1	60
60	3	18	1	6 ROOF TOP-94	114				1	60
60	3	18	1	6 ROOF TOP-95	115				1	60
60	3	18	1	6 ROOF TOP-96	116				1	60
60	3	18	1	6 ROOF TOP-97	117				1	60
60	3	18	1	6 ROOF TOP-98	118				1	60
60	3	18	1	6 ROOF TOP-99	119				1	60
60	3	18	1	6 ROOF TOP-100	120				1	60
60	3	18	1	6 ROOF TOP-101	121				1	60
60	3	18	1	6 ROOF TOP-102	122				1	60
60	3	18	1	6 ROOF TOP-103	123				1	60
60	3	18	1	6 ROOF TOP-104	124				1	60
60	3	18	1	6 ROOF TOP-105	125				1	60
60	3	18	1	6 ROOF TOP-106	126				1	60
60	3	18	1	6 ROOF TOP-107	127				1	60
60	3	18	1	6 ROOF TOP-108	128				1	60
60	3	18	1	6 ROOF TOP-109	129				1	60
60	3	18	1	6 ROOF TOP-110	130				1	60
60	3	18	1	6 ROOF TOP-111	131				1	60
60	3	18	1	6 ROOF TOP-112	132				1	60
60	3	18	1	6 ROOF TOP-113	133				1	60
60	3	18	1	6 ROOF TOP-114	134				1	60
60	3	18	1	6 ROOF TOP-115	135				1	60
60	3	18	1	6 ROOF TOP-116	136				1	60
60	3	18	1	6 ROOF TOP-117	137				1	60
60	3	18	1	6 ROOF TOP-118	138				1	60
60	3	18	1	6 ROOF TOP-119	139				1	60
60	3	18	1	6 ROOF TOP-120	140				1	60
60	3	18	1	6 ROOF TOP-121	141				1	60
60	3	18	1	6 ROOF TOP-122	142				1	60
60	3	18	1	6 ROOF TOP-123	143				1	60
60	3	18	1	6 ROOF TOP-124	144				1	60
60	3	18	1	6 ROOF TOP-125	145				1	60
60	3	18	1	6 ROOF TOP-126	146				1	60
60	3	18	1	6 ROOF TOP-127	147				1	60
60	3	18	1	6 ROOF TOP-128	148				1	60
60	3	18	1	6 ROOF TOP-129	149				1	60
60	3	18	1	6 ROOF TOP-130	150				1	60
60	3	18	1	6 ROOF TOP-131	151				1	60
60	3	18	1	6 ROOF TOP-132	152				1	60
60	3	18	1	6 ROOF TOP-133	153				1	60
60	3	18	1	6 ROOF TOP-134	154				1	60
60	3	18	1	6 ROOF TOP-135	155				1	60
60	3	18	1	6 ROOF TOP-136	156				1	60
60	3	18	1	6 ROOF TOP-137	157				1	60
60	3	18	1	6 ROOF TOP-138	158				1	60
60	3	18	1	6 ROOF TOP-139	159				1	60
60	3	18	1	6 ROOF TOP-140	160				1	60
60	3	18	1	6 ROOF TOP-141	161				1	60
60	3	18	1	6 ROOF TOP-142	162				1	60
60	3	18	1	6 ROOF TOP-143	163				1	60
60	3	18	1	6 ROOF TOP-144	164				1	60
60	3	18	1	6 ROOF TOP-145	165				1	60
60	3	18	1	6 ROOF TOP-146	166				1	60
60	3	18	1	6 ROOF TOP-147	167				1	60
60	3	18	1	6 ROOF TOP-148	168				1	60
60	3	18	1	6 ROOF TOP-149	169				1	60
60	3	18	1	6 ROOF TOP-150	170				1	60
60	3	18	1	6 ROOF TOP-151	171				1	6

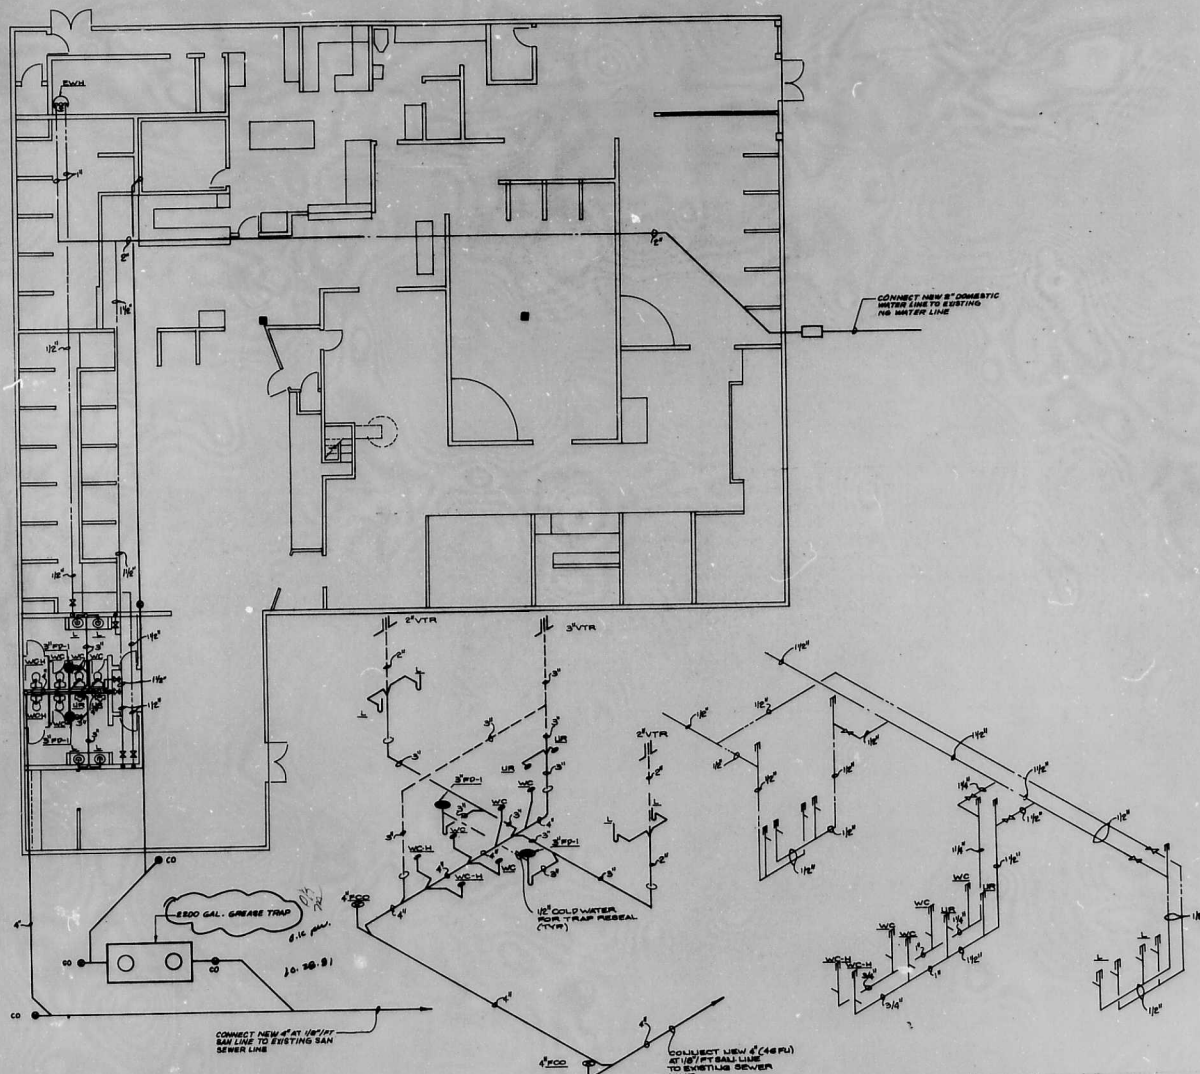

△ PUBLIC TOILETS SANITARY RISER DIAGRAM
N.T.S.

PUBLIC TOILETS DOMESTIC WATER RISER DIAGRAM
N.T.S.

Manuel E. Laurindo & Assoc., Inc.
CONSULTING ENGINEERS
BIRMINGHAM, ALABAMA 35203



DATE	2/27/75
BY	ML
CHECKED	
DRAWN	

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. Holladay Blvd. Suite 202 - Holladay, Fla. 33009
Phone (305) 456-2702

PIZZA TIME THEATRE
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA

william cook murphy
architect a.i.a.
1001 N. KENNESAW AVE., SUITE 1000, MIAMI, FL 33132

Manuel E. Laurindo 66770



NOTE: THE GENERAL CONTRACTOR IS RESPONSIBLE FOR THE REMOVAL, CLEANING AND WAXING OF ALL HARD FLOORS

**william
m u r p h y
architect a.i.a.**

Phone: (305) 456-2702


2

6677D

-
- Diagram illustrating a diamond-shaped room layout with labels: WALL, CEILING, FLOOR, WALL, WALL, and WALL.

-


- 3



TYPICAL HAMPOL FOR WALL WASHES
APPROXIMATELY THREE FEET FROM
WALL, ACCUR. AT THE CENTER OF
THE TIE OF, ORDER, BAR AND
BOLTS


CONCRETE BLOCK PAINTED WITH SHERWIN WILLIAMS EX BM3-E
SPEC. 82-54

1/4"

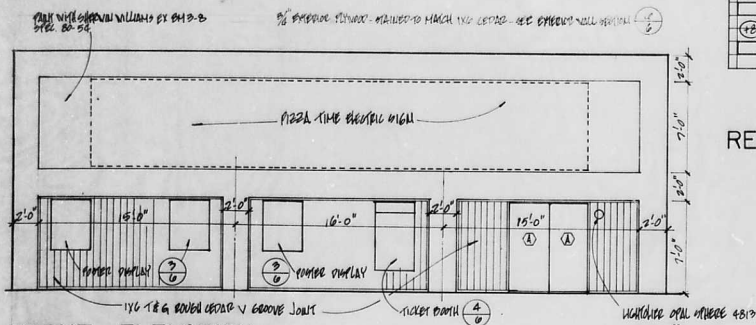

FRONT ELEVATION

1/4"

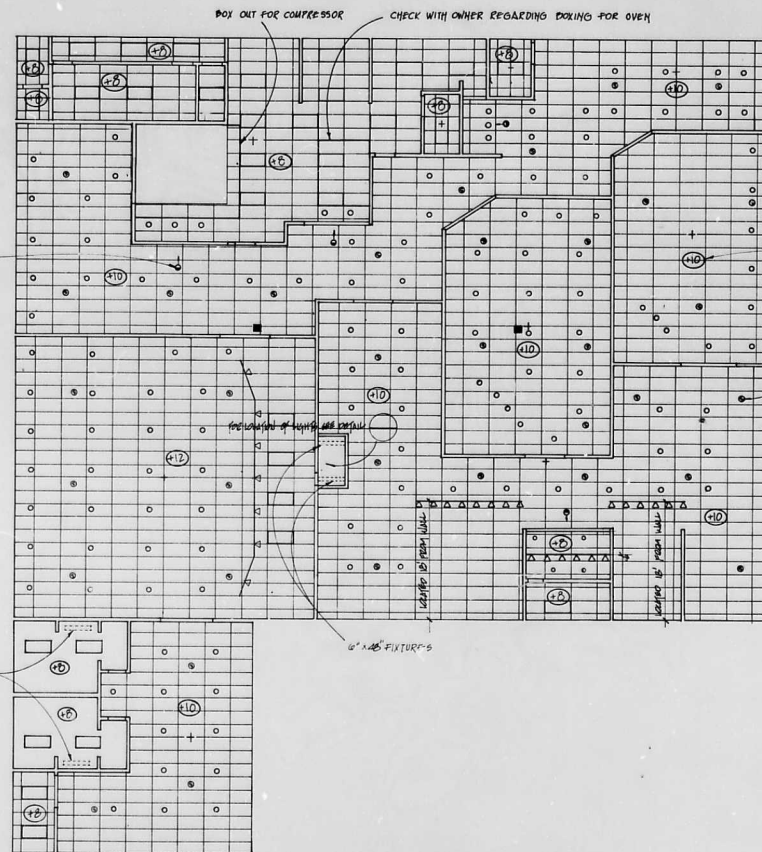

BOX OUT FOR COMPRESSOR

- CHECK WITH OWNER REGARDING DOXING FOR OVEN

REPRESENTS HEIGHT FROM
FINISHED CEILING TO FINISHED
FLOOR

— SPILLWAYS LOCATIONS FOR CEILING
WEAKER. TYPICAL

6" x 4" FIXTURE

REFLECTED CEILING PLAN

1/8"

william cook
murphy
architect a.i.a.








KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
109 W. Hollaender Bld. • Suite 202 • Hollywood, FL 33008
Phone: (305) 466-2702

PIZZA TIME THEATRE
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA

[illegible]

15

66775

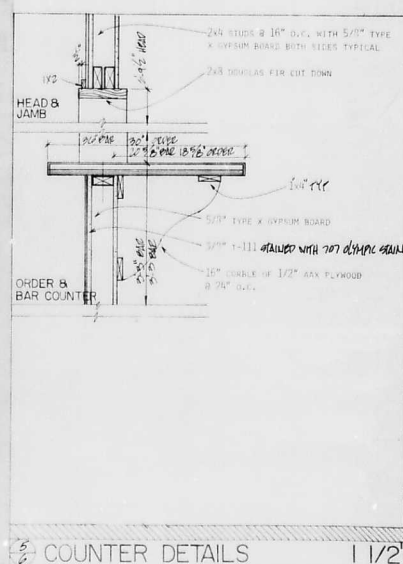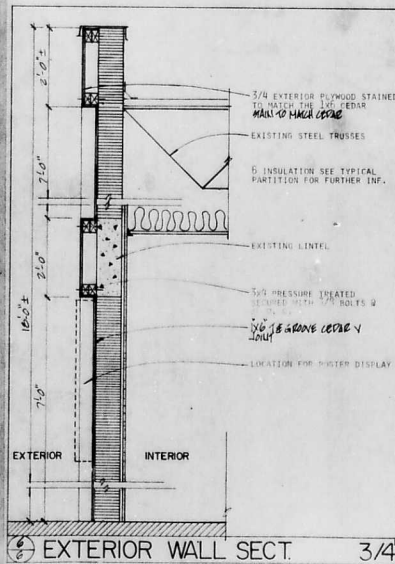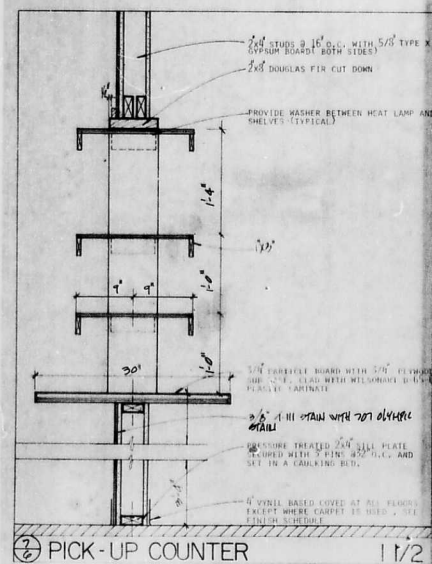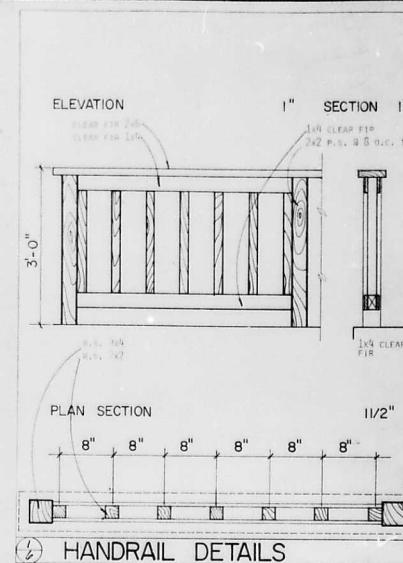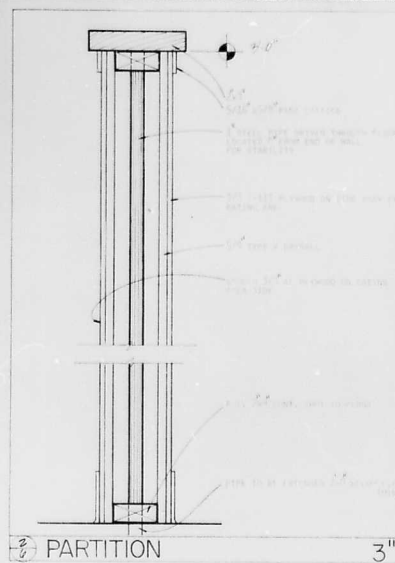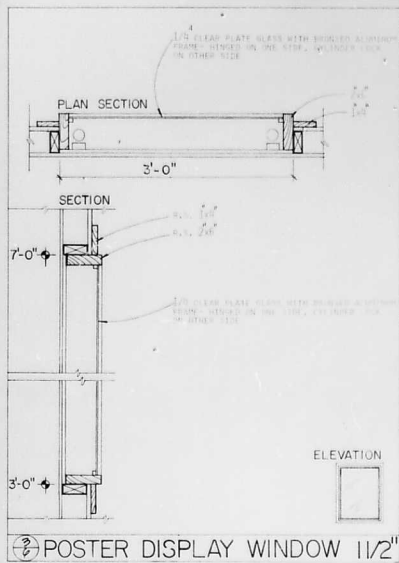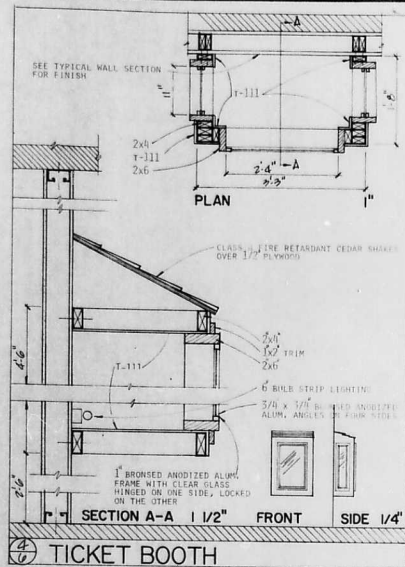


william cook murray architect a.i.a.
700 N. KENDALL DR. SUITE 206 MIAMI, FL 33156 305 669 8940

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
409 W. HIGHLAND BLVD. SUITE 202 MIAMI, FL 33130
Phone: (305) 456-2702

PIZZA TIME THEATRE
Greece City, Ohio
COUNTRYSIDE VILLAGE SQUARE
CLEARWATER, FLORIDA


6

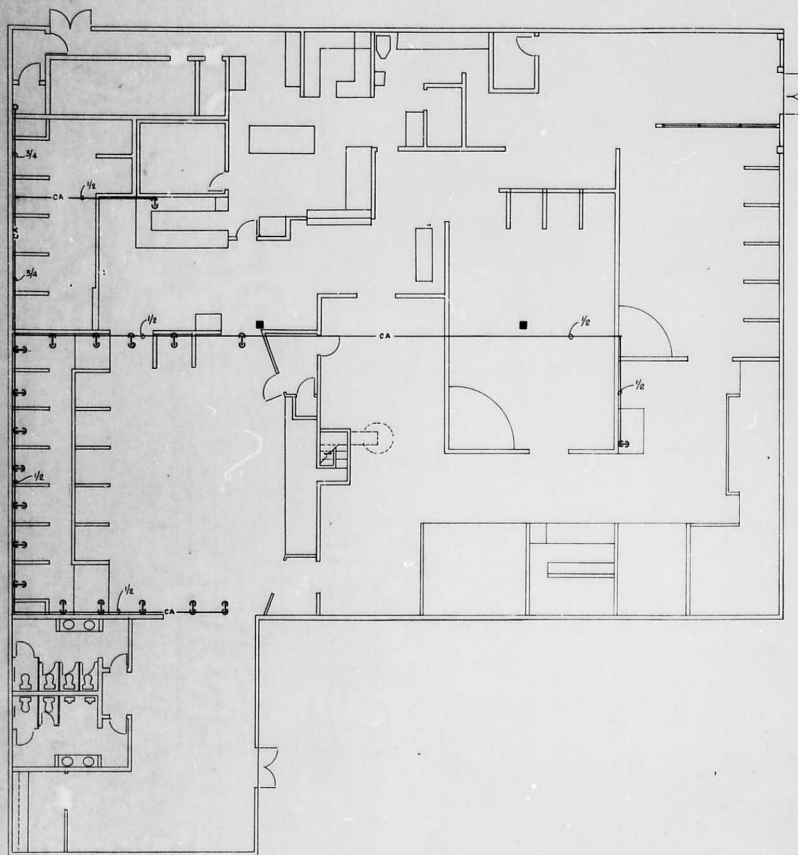

FLOOR PLAN
SCALE 1/8"=1'-0"


- (A) FILTER HEAT EXCHANGER 12" DIA. SUPPLIED BY PTT INC.
(B) AIR COMPRESSOR 1HP WITH 117V 50/60 HZ 20 PSI. 1/2" INLET PRESSURE
LATERAL SWITCH 4.0 CM.
(C) REFRIGERATION COMPRESSOR AIR DRYER RATED CAPACITY 100 CFM
INLET AIR PRESSURE 100 PSI 117V SINGLE PHASE

ALL ELECTRIC UNIT MUST BE UL LISTED SYSTEMS MUST BE PRESSURE
TESTED TO 100 PSI TO REGULATOR IN FILTER REGULATOR 80 & 70 PSI
COMPRESSOR OIL TYPE 30 WEIGHT NON DETRIMENT.

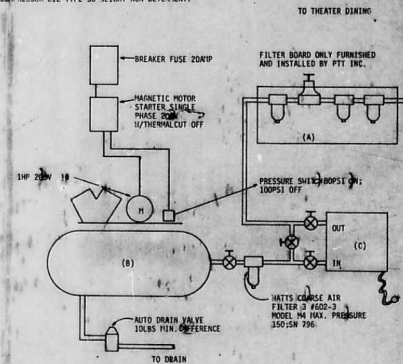

COMPRESSOR DIAGRAM

N.T.S.

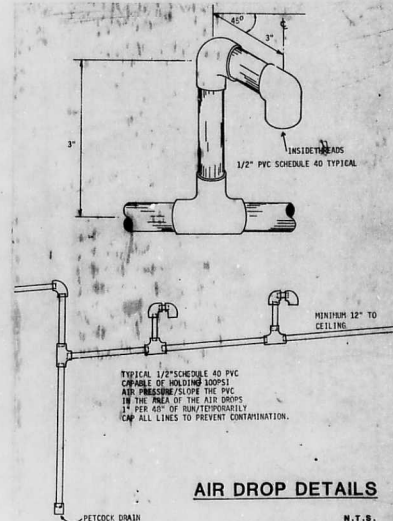

AIR DROP DETAILS

N.T.S.

Manuel E. Lauro & Assoc., Inc.
CONSULTING ENGINEERS
MAJOR FLOOR 1018



PIZZA TIME THEATRE

COUNTRY/GEORGE VILLAGE SOUTH
CLEVELAND, OHIO

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT


409 W. Hialeah Blvd. Suite 202 Hialeah, FL 33009
Phone (305) 566-2702

**william cook
murphy
architect
a.i.a.**
700 N. KENDALL DR. SUITE 208 MIAMI, FL 33156 305 565 1840

DATE	REVISIONS	CHECKED
01-11-81	01-11-81	

E-4

64272

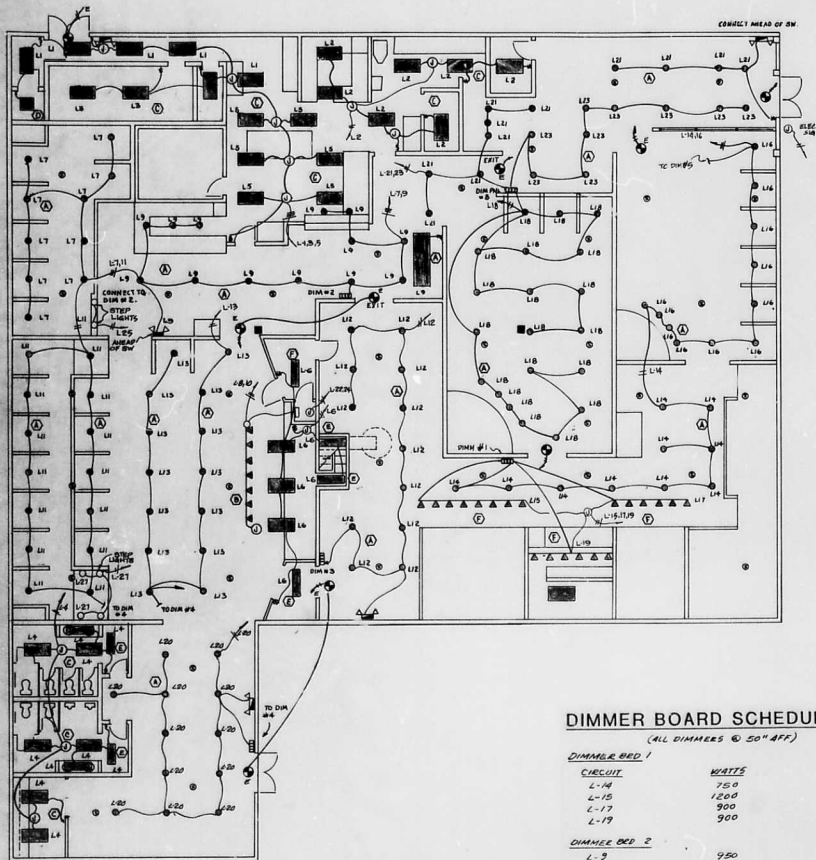

REFLECTED CEILING PLAN
SCALE: 1/8" = 1'-0"

DIMMER BOARD SCHEDULE
(ALL DIMMERS @ 50" AFF.)

DIMMER BOARD 1	
CIRCUIT	WATTS
L-14	750
L-15	1200
L-17	900
L-19	900

DIMMER BOARD 2	
L-3	950
L-7	750

DIMMER BOARD 3	
L-12	900

DIMMER BOARD 4	
L-11	1050
L-13	1050
L-20	900

DIMMER BOARD 5	
L-18	1500
L-21	825
L-23	825
L-24	825

ALL DIMMERS SHALL BE HUNT ANDERSON OF EQUAL

GENERAL NOTES

1. CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS AND EQUIPMENT REQUIRED FOR A COMPLETE ELECTRICAL INSTALLATION IN ACCORDANCE TO THESE DRAWINGS.
2. COMPLY WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE AND ALL THE LOCAL STANDARD BUILDING CODES.
3. PROVIDE EMPTY CONDUITS AS REQUIRED FOR TELEPHONE AND INTERCOM SYSTEMS.
4. PROVIDE ALL REQUIRED CONNECTIONS FOR OTHER TRADES.
5. OBTAIN ALL PERMITS FOR WORK UNDER THIS CONTRACT.
6. PROVIDE TEMPORARY POWER AND LIGHT OUTLETS FOR USE BY OTHER TRADES.
7. COORDINATE ALL BOX LOCATIONS WITH BUILDING ARCHITECTURAL FEATURES.
8. CONTRACTOR SHALL VISIT THE SITE AND FAMILIARIZE HIMSELF WITH ALL EXISTING CONDITIONS.
9. ALL CABLE SHALL BE COPPER.
10. INDOOR CONDUIT SHALL BE ENT.
11. OUTDOOR UNDERGROUND CONDUITS SHALL BE SCHEDULE 40 PWC UNDER PAVED AREAS. IT SHALL BE EMBEDDED IN CONCRETE. MINIMUM COVER SHALL BE 18 INCHES.
12. ALL MOUNTING HARDWARE SHALL BE BY ELECTRICAL CONTRACTOR.

LEGEND

- WALL SWITCH 20 A 125 V.
- DUPLEX RECEPTACLE OUTLET.
- SPECIAL RECEPTACLE OUTLET.
- PHONE OUTLET.
- TV OUTLET.
- DIMMER SWITCH.
- INCANDESCENT LIGHTING FIXTURE.
- FLUORESCENT LIGHTING FIXTURE.
- WALL BRACKET.
- LIGHTING PANEL.
- POWER PANEL.
- HOME RUN TO PANEL.
- DISCONNECTING SWITCH.
- FUSE SWITCH 2 POLES 200 A, 150 A, FUSES.
- CIRCUIT BREAKER.
- 3-WAY SWITCH 20 A, 125 V.


Manuel E. Lauredo & Associates, Inc.
ELECTRICAL ENGINEERS
501 N. W. 10th Avenue
Suite 1000, Fort Lauderdale, Florida 33304

DATE: 01/22/81
BY: [Signature]
CHECKED: [Signature]
DRAWN: [Signature]


william cook murray architect a.i.a.
700 N. KENDALL DR. SUITE 206 MIAMI, FL 33156 305 663 8840

KLAUDER AND ASSOCIATES, P.A.
CONSTRUCTION MANAGEMENT
405 W. Hollander Blvd. Suite 202 - Hollywood, FL 33008
Phone: (305) 456-2702

PIZZA TIME THEATRE
COUNTRY CLUB VILLAGE SQUARE
CLEARWATER, FLORIDA

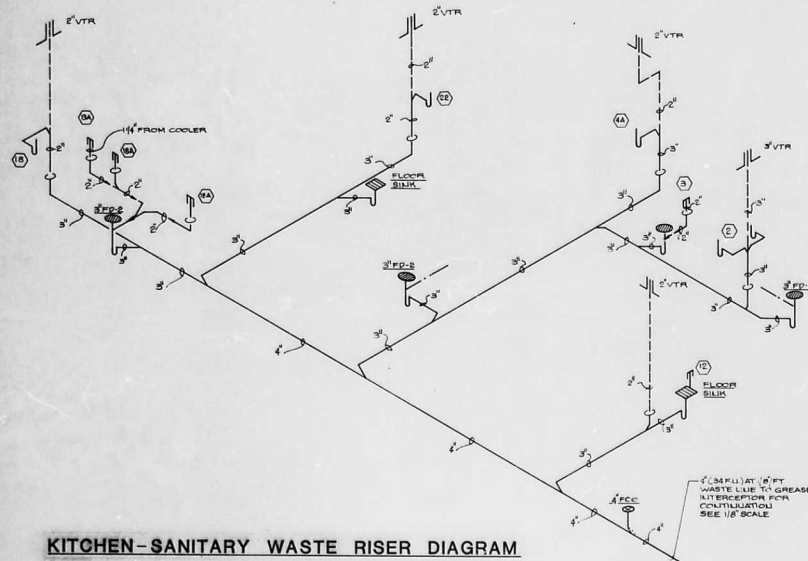

KITCHEN-SANITARY WASTE RISER DIAGRAM
N.T.S.

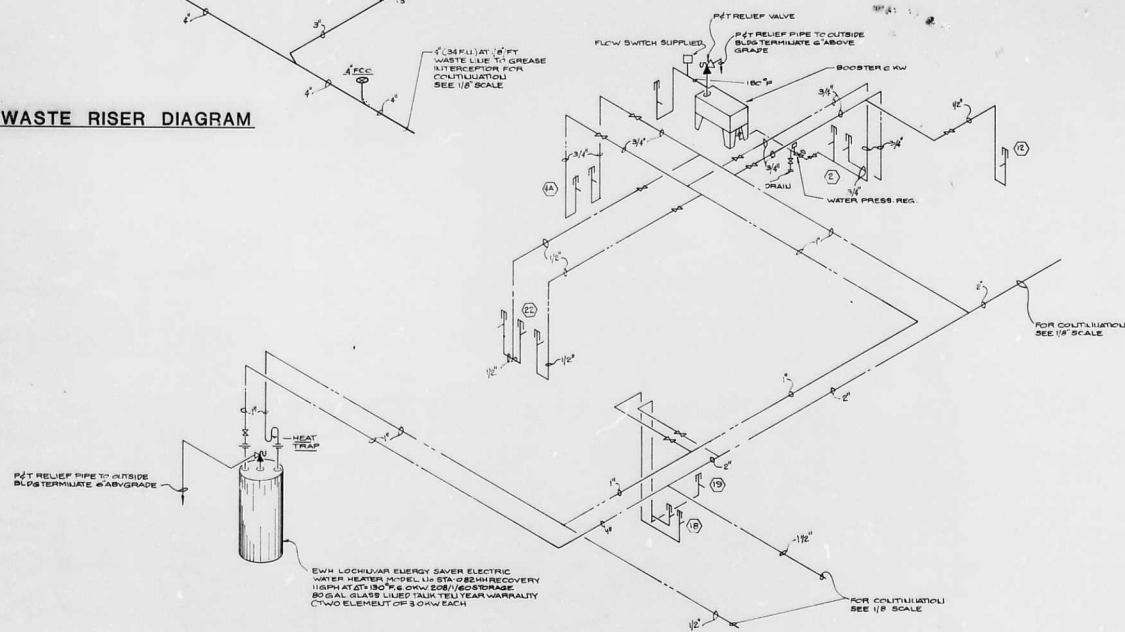

KITCHEN-DOMESTIC WATER RISER DIAGRAM
N.T.S.

Manual E. Laurado & Assoc., Inc.



DATE: 10/1/81

BY: M. E. LAURADO

CHECKED: M. E. LAURADO

DRAWN: M. E. LAURADO

SCALE: 1/8\"/>

PROJECT: P-3

CLIENT: PIZZA TIME THEATRE

LOCATION: COUNTRYSIDE VILLAGE SOUTH FLORIDA

DESIGNER: KLAUDER AND ASSOCIATES, P.A.

MANAGER: CONSTRUCTION MANAGEMENT

ADDRESS: 409 W. HOLLAND BLVD. SUITE 202 HOLLAND, FL 33006

PHONE: (305) 466-2702

ARCHITECT: WILLIAM COOK ARCHITECT A.I.A.

ADDRESS: 700 N. KENDALL DR. SUITE 303 MIAMI, FL 33156

PHONE: 305-665-1940